PRELIMINARY
NOT FOR
CONSTRUCTION

TULARE LOCAL HEALTHCARE DISTRICT
TULARE TOWER

TULARE, CALIFORNIA

THIS DOCUMENT CONTAINS INFORMATION THAT IS PROPRIETARY TO DAVIS, STOKES COLLABORATIVE, P.C. THIS DOCUMENT AND/OR ITS CONTENTS MAY NOT BE REPRODUCED OR DISCLOSED TO OTHERS, EITHER IN WHOLE OR IN PART, WITHOUT THE PRIOR WRITTEN CONSENT OF DAVIS, STOKES COLLABORATIVE, P.C.
COPYRIGHT 2018, ALL RIGHTS RESERVED

DSC ARCHITECTS
DAVIS STOKES COLLABORATIVE P.C.
7121 CROSSROADS BLVD
BRENTWOOD, TN 37027
TEL (615) 726-0010
MAIL dscinfo@dsccol.com
WEB www.dsccol.com

REVISIONS

NO.	DATE	DESCRIPTION

PHASE ONE HIGH
ROOF PLAN PART B

A4.02

ISSUE DATE: 02.02.24
JOB NUMBER: 19031

WALL LEGEND:

THIS IS AN ABBREVIATED LEGEND. REFER TO FOR COMPLETE DESCRIPTION AND PRECISE REQUIREMENTS.

WALLS ON THE PLAN DRAWINGS ARE INDICATED BY PLAN SYMBOLS.

2-HOUR RATED FIRE & SMOKE RESISTANT BARRIER WALL: 6"X16 GA STUDS WITH 2 LAYERS 5/8" TYPE "X" GYP. BD. EA. SIDE; FULL HGT. WITH FULL HGT. SOUND INSULATION UNLESS OTHERWISE MODIFIED.

2-HOUR RATED FIRE & SMOKE RESISTANT SHAFT WALL: 4"X20 GA C-H STUDS WITH 1" FILLER PANELS @ SHAFT SIDE & 2 LAYERS 5/8" TYPE "X" GYP. BD. @ RM. SIDE; FULL HGT. WITH FULL HGT. SOUND INSULATION UNLESS OTHERWISE MODIFIED.

SMOKE BARRIER WALL: 6"X16 GA STUDS WITH 5/8" TYPE "X" GYP. BD. EA. SIDE FULL HGT. W/FULL HGT SOUND INSULATION UNLESS OTHERWISE MODIFIED.

1-HOUR FIRE BARRIER WALL: 6"X16 GA STUDS WITH 5/8" TYPE "X" GYP. BD. EA. SIDE; FULL HGT. W/FULL HGT. SOUND INSULATION UNLESS OTHERWISE MODIFIED.

SMOKE BARRIER/ 1-HOUR RATED FIRE BARRIER WALL: 6"X16 GA STUDS WITH 5/8 TYPE "X" GYP. BD. EA. SIDE; FULL HGT. W/FULL HGT. SOUND INSULATION UNLESS OTHERWISE MODIFIED.

1-HOUR CORRIDOR WALL: 6"X 16 GA STUDS WITH 5/8" TYPE "X" GYP. BD. EA. SIDE; FULL HGT. W/FULL HGT. SOUND INSULATION.

1-HOUR FIRE-RESISTIVE CONSTRUCTION: 6"X16 GA STUDS WITH 5/8" TYPE "X" GYP. BD. EA. SIDE; FULL HGT. W/FULL HGT. SOUND INSULATION, UNLESS OTHERWISE MODIFIED.

1-HOUR FIRE-RESISTIVE CONSTRUCTION: 6"X16 GA STUDS WITH 5/8" TYPE "X" GYP. BD. EA. SIDE; EXTERIOR SIDE & 5/8" GYP. BD. FULL HGT @ INTERIOR SIDE. WITH R-19 THERMAL INSULATION, UNLESS OTHERWISE MODIFIED.

TYPICAL POURED CONCRETE WALL. REFER TO STRUCTURAL DRAWINGS FOR THICKNESS.

FURRING WALL. FIRE RESISTIVE RATING WHERE INDICATED:
1-5/8" STUD FURRING WITH 5/8" GYP. BD. ONE SIDE, UNLESS OTHERWISE MODIFIED.

0 2 4 8 16

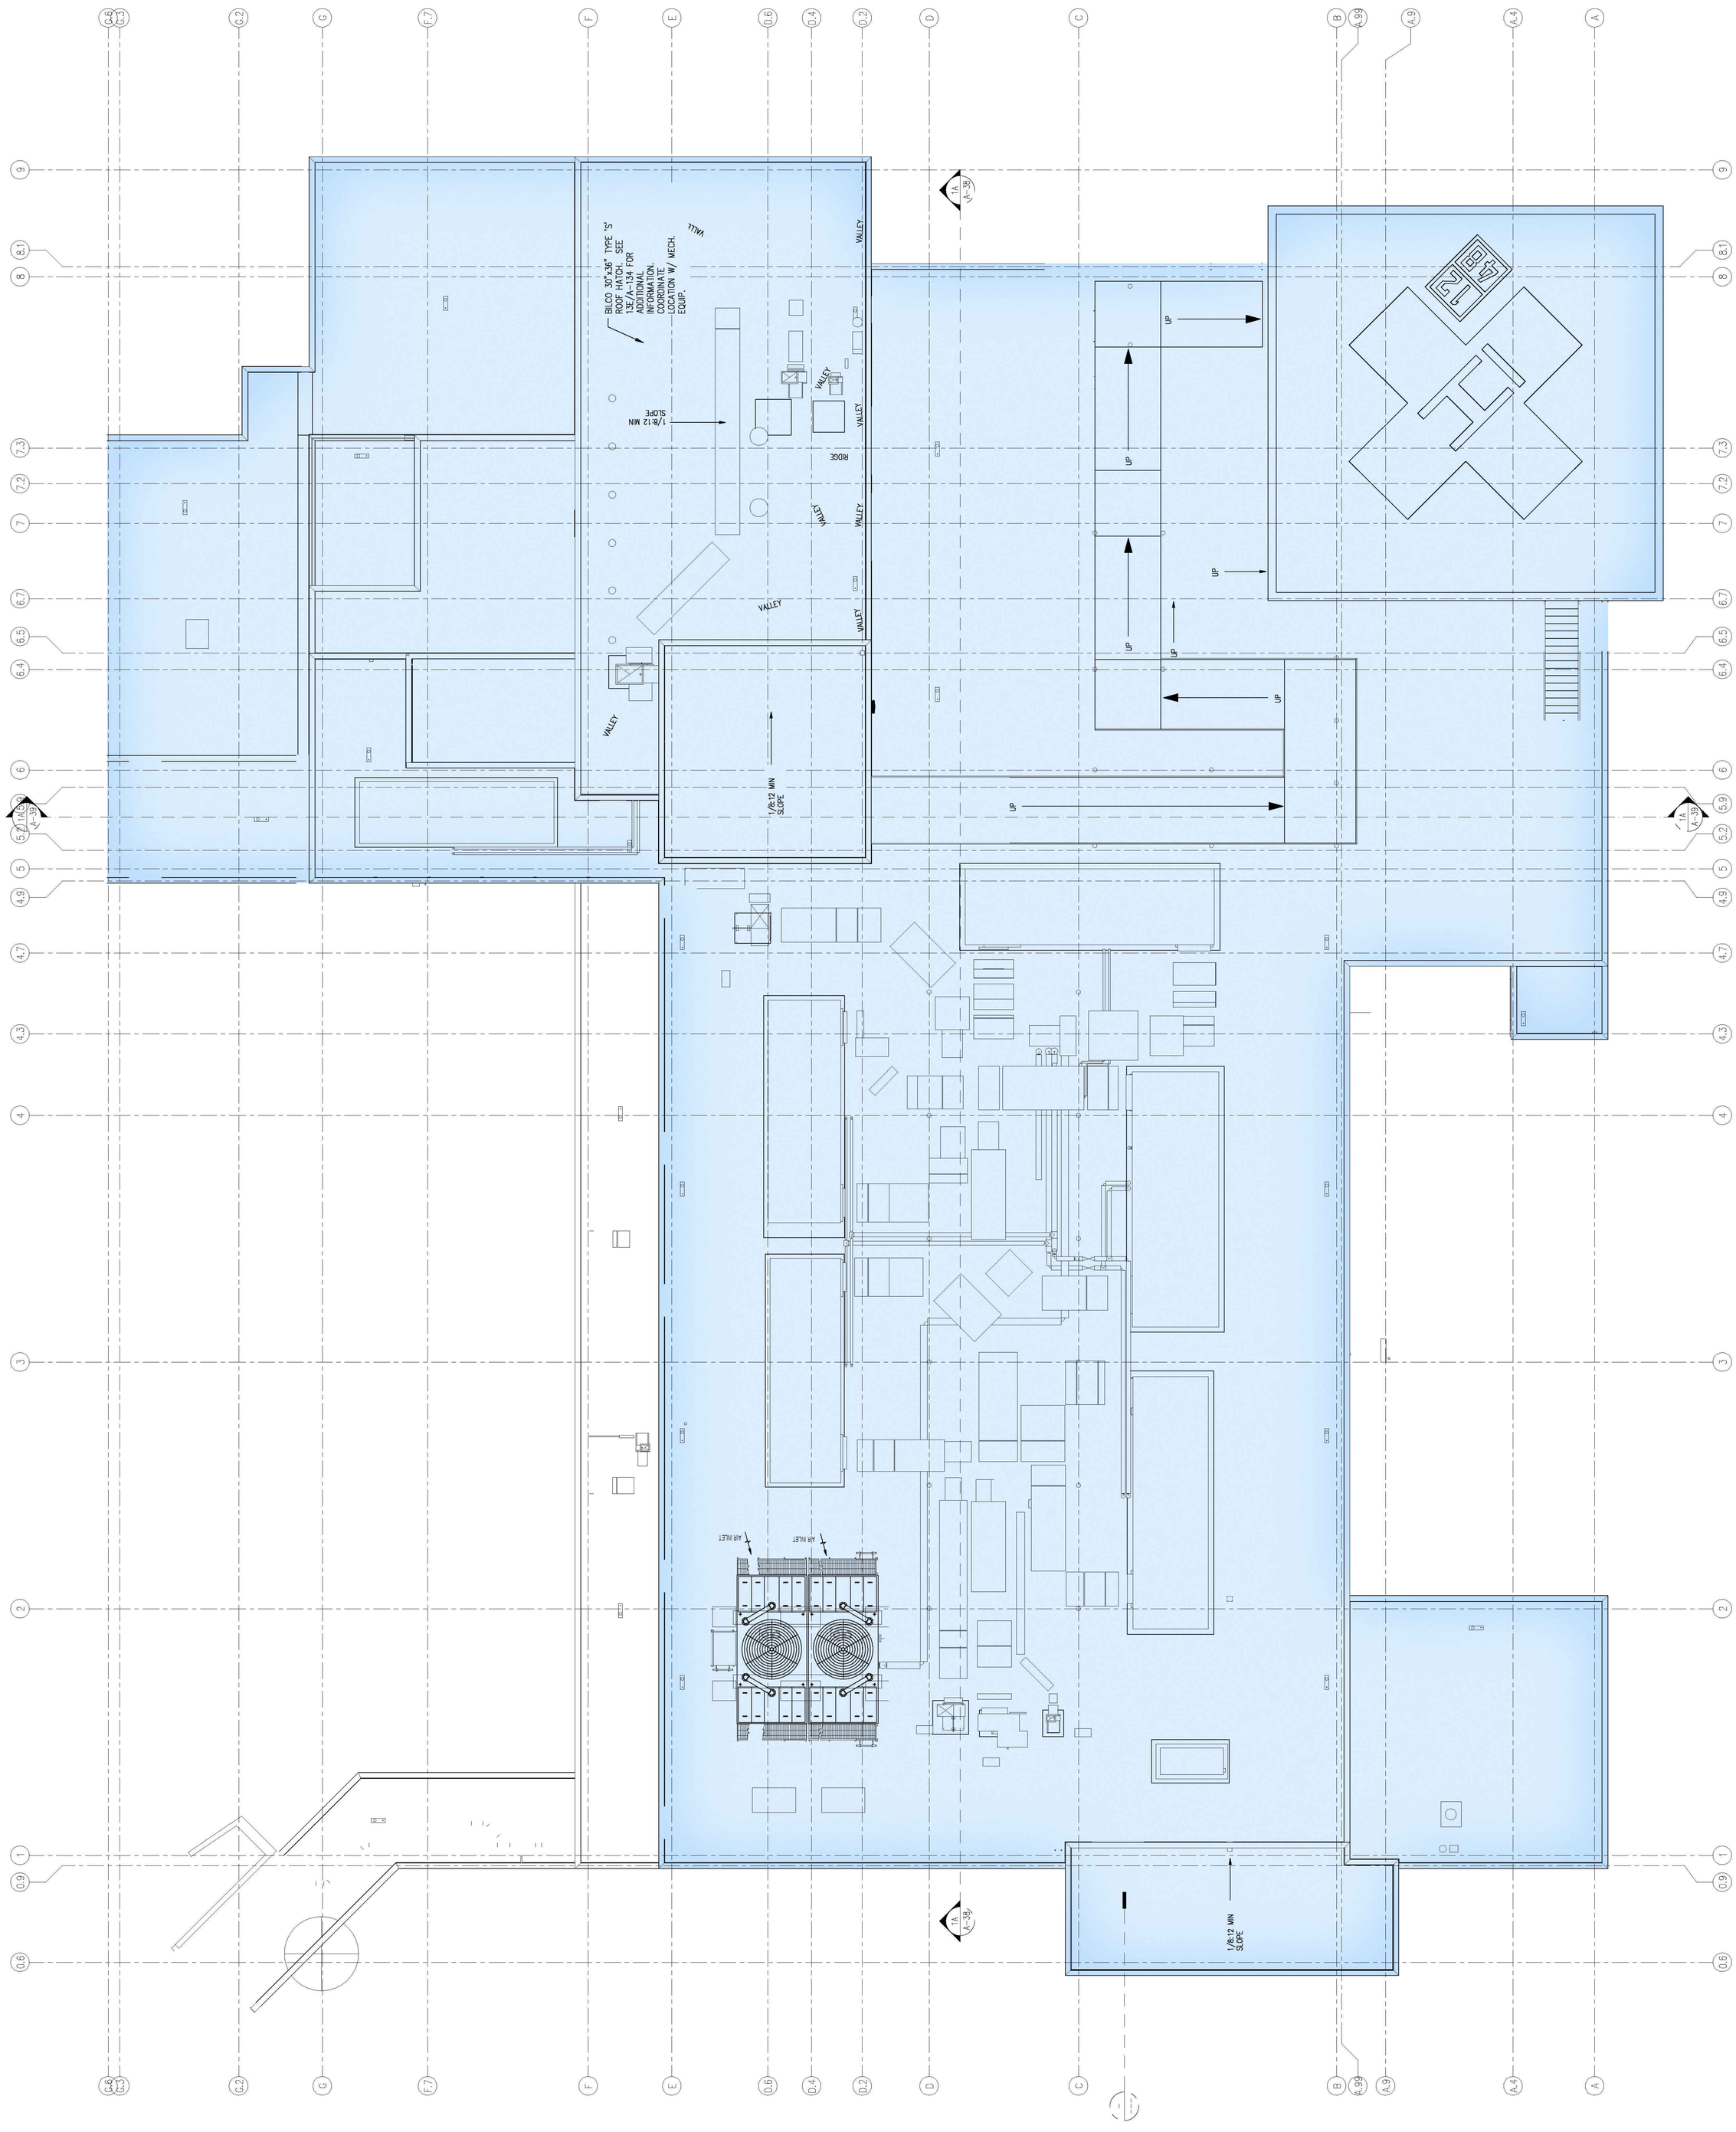

| | | |